

ng_in_Increasing_Power_Qualit y_in_Radial_Distribution_Syste m.pdf *by*

Submission date: 30-Jul-2023 08:54PM (UTC-0700)

Submission ID: 2139261321

File name: ng_in_Increasing_Power_Quality_in_Radial_Distribution_System.pdf (867K)

Word count: 3726

Character count: 19303

The Effect of Single Tuned Filter on Coordinated Planning in Increasing Power Quality in Radial Distribution System

¹ Muhira Dzar Faraby
Department of Mechatronic
Engineering
Polytechnic of Bosowa
Makassar, Indonesia
muhira_faraby@yahoo.com

² Anisya Sonita
Department of Informatic Engineering
University of Muhammadiyah Bengkulu
Bengkulu, Indonesia
anisyaasonita@umb.ac.id

³ Nurhayati
Department of Electrical Engineering
State Polytechnic of Ujung Pandang
Makassar, Indonesia
nurhayati_tmj@poliupg.ac.id

Abstract—The use of nonlinear loads in the distribution system becomes a separate problem in increasing the spread of harmonics which can reduce power quality. The effect of placing a single tuned filter was investigated to minimize total active power losses and minimum %THDv against coordinated planning that had been carried out previously using the particle swarm optimization method by considering the distribution of validated harmonics on the IEEE 69 bus Test Standard System with the constrain specified. The effectiveness of the proposed plan can reduce total active power losses up to 59.61% and reduce the value of %THDv in each bus up to 55.18%.

Keywords—Single Tuned Filter, Coordinated Planning, Particle Swarm Optimization, Harmonic, Power Quality.

I. INTRODUCTION

Increasing trend to utilized power electronic interfaced devices as nonlinear load is the main reason of the higher harmonic distortion level in modern power distribution systems [1]. Nonlinear loads are semiconductor devices that are easy to operate and control, but they can also cause the spread of harmonics that adversely lead to the equipment damage. According to IEEE Standard 119-2014, harmonics are defective waves due to distortion of a sinusoidal wave with a frequency multiple of integers from the fundamental frequency with a value of % THDv <5% [2-3].

The use of filters is one of the optimization techniques developed as an effective solution to reduce the spread of harmonics in a radial distribution system [4]. Several previous studies benefited from the use of active filters in mitigating the spread of harmonics. However, the use of single filters is still widely used because of easier implementation, low investment costs and easier maintenance. [5,6].

The effects of harmonic spread can be known using the Forward Backward Method (FBS) to find currents, voltages and power losses at fundamental frequencies [7]. In addition, the Harmonic Load Flow Method (HLF) is a method used to find currents, voltages and power losses for each harmonic order. The effect of current and voltage distortion is very large on the spread of harmonics in odd order harmonics due to the use of nonlinear loads. Therefore, proper and intelligent planning is needed to overcome it [8,9].

Utilization and development of renewable energy as an energy source provide the need for Distributed Generation (DG) based electrical energy which is considered capable of improving the voltage profile, reducing power losses and improving power quality in mitigating the harmonic spreads [10-12]. Capacitors as the reactive power compensation equipment are also considered capable in this regard but proper and strategic planning is needed in terms of improving

power quality in mitigating the harmonic spreads because the resonance effect generated by improperly planned capacitors can make the system worse [13]. Network reconfiguration is an optimization technique which is also considered effective in minimizing power losses emerging in the distribution system by changing the network configuration by activating the tie switch after selecting the available sectional switch without any investment costs [14,15]. The system harmonic impedance value is affected by grid configuration and load pattern. It means that applying new configurations and load patterns may result in some changes in the index of power quality of the distribution systems [16]. Coordinated planning is a planning that coordinates several optimization techniques used to get objective functions. However, this is a complex matter in maintaining the quality of the system with the needs and increased of the existing load, especially the use semiconductor devices on both sides of household users, offices and industry [17,18].

In the previous study [17], coordinated planning for DG placement optimization, capacitor placement and reconfiguration simultaneously using PSO considering the use of nonlinear loads have been presented in several validated case studies. On the IEEE 33-bus system and IEEE 69-bus, there was a decrease in total losses by 67.89% and a decrease in the value of % of THDv. On the IEEE 69-bus system, there was a decrease in total losses by 39.62%, but the % THDv value system for some buses was outside the permitted limits. Optimization planning for the placement of a single tuned filter before and after DG placement gives better results to minimize active power losses in the radial distribution system, keeps the rms voltage with the prescribed limit, and decreases the total harmonic distortion level [19].

The kind practice of the distribution system is expected to be able to overcome power quality problems. Nonoptimal planning in finding the objective function can cause the system to be in a bad condition that it can even be damaged due to harmonic problems. Several artificial intelligence-based studies use the Adaptive Bacterial Foraging Optimizations [6], PSO [19], WAO [20], NSGA-II [21], A Graph Search Algorithm [22] and ant colony methods [23]. This research is a continuation study of [17] in the optimal placement and sizing of the single tuned filter to minimize total losses and % THDv which will be tested on the IEEE 69-bus radial distribution system using PSO method in several scenarios to get the better result on improving power quality.

II. MODELING SYSTEM

A. Harmonic Power Flow

The Harmonic Load Flow Algorithm (HPF) was introduced by Teng [6]. The Backward sweep algorithm of harmonic load flow is used to obtain matrix $[A]$ representing the relationship between the branch current and injection current bus for h harmonic sequence. [20] forward sweep produces a $[HA]$ matrix representing the relationship between harmonic bus voltage and harmonic bus injection current. To find the current flowing from $i - j$ branch is used Backward sweep current equation;

$$[B_{i-j}^{(h)}] = [A_{i-j}^{(h)}] * [I_{i-j}^{(h)}] \quad (1)$$

$$[A_{i-j}^{(h)}] = \begin{bmatrix} Ah_{i-j}^{(h)} \\ \vdots \\ Ah_{i-j}^h \end{bmatrix} \quad (2)$$

where $[A_{i-j}^{(h)}]$ is coefficient vector of branch $i - j$ to the presence of harmonic current absorbed. To get harmonic voltage on each bus is used Forward Sweep voltage equation;

$$[V_{i-j}^{(h)}] = [Z_{i-j}^{(h)}] * [B_{i-j}^{(h)}] \quad (3)$$

$$[V_j^{(h)}] = [V_j^{(h)}] - [V_{i-j}^{(h)}] \quad (4)$$

$$[V^{(h)}] = [HA^{(h)}] * [I^{(h)}] \quad (5)$$

The value of the harmonic voltage bus is calculated with an iteration less than or an equal to the tolerance determined by ϵ .

$$|V_i^{(h),k+1} - V_i^{(h),k}| \leq \epsilon \quad (6)$$

Total active power losses can be written with vector from as follows;

$$P_{Loss}^{(h)} = \sum_{i=1}^{br} P_{Loss_i}^{(h)} = \sum_{i=1}^{br} \sum_{h=h_0}^{h_{max}} |B_i^{(h)}|^2 R_i^{(h)} \quad (7)$$

$$P_{Loss}^{(h)} = [R^{(h)}]^T * [A^{(h)}] * [I^{(h)}]^T \quad (8)$$

The voltage values of rms bus i (V_{rms_i}) and THD can be calculated as follows;

$$V_{rms_i} = \sqrt{|V_i^{(1)}|^2 + \sum_{h=h_0}^{h_{max}} |V_i^{(h)}|^2} \quad (9)$$

$$THD = \frac{\sqrt{\sum_{h=h_0}^{h_{max}} |V_i^{(h)}|^2}}{|V_i^{(1)}|^2} \quad (10)$$

B. Single Tuned Filter

The harmonic filter is designed to suppress the amplitude of one or more frequencies of a voltage or current. With the installation of a harmonic filter on an electrical distribution network containing a harmonic source, the spread of harmonic current throughout it can be reduced. Furthermore, harmonic filters at fundamental frequencies can equal for the reactive power used to increase the power factor of the systems [4]. Single tuned filter is one of passive filters

consisting of passive components that R, L and C in series. Single tuned filter is most widely used in industrial power systems in terms of overcoming harmonics [6]. This is because it is more efficient [19-23].

C. Particle Swarm Optimization

Particle Swarm Optimization (PSO) is one of evolutionary computing techniques, in which the population on PSO is based on algorithmic search and begins with a random population called a particle. The standard procedure in applying PSO algorithm starts from population initialization to fitness function evaluation, compares fitness particle evaluation with P_{best} identifies particle result at best fitness value, updates position of particle and determines direction with best fitness on specified iteration [20].

III. METHODOLOGY

A. Objective Function

The purpose of this research is to find a multi-objective function in the form of

- Minimal total power losses

$$P_{Loss} = \sum_{i=1}^{nb} P_{Loss_i}^{(1)} + \sum_{i=1}^{nb} \sum_{h=h_0}^{h_{max}} P_{Loss_i}^{(h)} \quad (11)$$

$$f(x)_1 = \min P_{Loss} \quad (12)$$

- Minimal THDv

$$\%V_{THD,i} = \frac{V_{d,i}}{V_{rms,i}} * 100\% \quad (13)$$

$$f(x)_2 = \min \%V_{THD,i} \quad (14)$$

$$f(x) = f(x)_1 + f(x)_2 \quad (15)$$

B. Constrain

- Bus Voltage Limit

$$V_{min}(0.95 pu) \leq V_{rms_i} \leq V_{max}(1.05 pu) \quad (16)$$

- Total Harmonic Distortion Limit

$$THD_i(\%) \leq THD_{max} \quad (17)$$

C. Single Tuned Filter Design

The step in designing single tuned filter on radial distribution system is as follows;

- Step 1. Determine X_c and C on $f_{fundamental}$

$$X_c = \frac{V^2}{Q_{filter}} \quad (18)$$

$$C = \frac{1}{2\pi f X_c} \quad (19)$$

- Step 2. Specifies X_L and L at $f^{(h)}$

$$L = \frac{1}{C(2\pi f_{tun})^2} \quad (20)$$

$$X_L = 2\pi f L \quad (21)$$

- Step 3. Calculate the R value for Q quality

$$R = \frac{X_n}{Q} \quad (22)$$

$$X_n = \sqrt{\frac{L}{C}} \quad (23)$$

Then, we will get impedance from filter;

$$Z_{filter} = R + j(X_L - X_C) \quad (24)$$

Thus, the $f^{(h)}$ of the h impedance of the single tuned filter is;

$$Z_{filter}^{(h)} = R^{(h)} + j(X_L^{(h)} - X_C^{(h)}) \quad (25)$$

D. Optimization by PSO

Optimization in determining placement and sizing single tuned filter uses PSO. The steps of PSO are;

- Generated population of particle by position and velocity randomly in a search of dimension space
- Evaluating the fitness function of all particle
- Comparing evaluation of particle with P_{best}
- Updating *velocity* and *particle* position
- Back to step 2. If the criteria are met, it usually stops if the fitness value improves.

Parameters of PSO used are population = 100; iteration = 100; $c_1 = 1$; $c_2 = 2$. The step of research carried out can be seen in Figure 2.


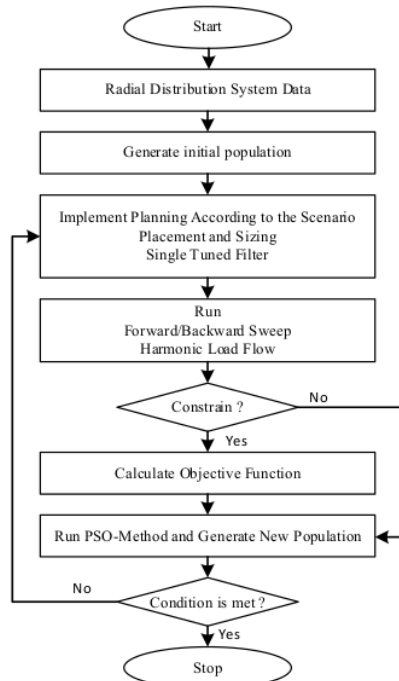


Fig 1. Step of the research.

E. IEEE 69-bus and Study Case

- IEEE 69-bus standard system.

The Harmonic source will be injected on bus 6, 9, 14, 17, 22, 27, 33, 37, 40, 43, 49, 55, 61 and 69.

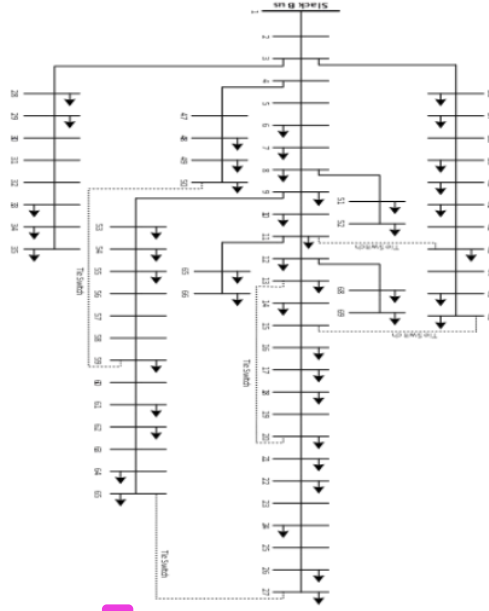

26
Fig 2. Single line diagram IEEE 69-bus system [15].

- Harmonic Source

As for the value of the injection of harmonic currents from the use of nonlinear loads can generate the harmonic spreads in this research can be seen in Table 1. On bus 5, 7, 9, 11, 14, 17, 20, 24, 27, 29, 31 and 33 will be injected the harmonic source [17]

TABLE 1. INJECTION OF HARMONIC SOURCE IN LOAD BUS [17-19]

Orde	Magnitude (%)	Angle
5	98	140
7	39.86	113
11	18.85	-158
13	9.79	-178
17	2.5	-94

- Study Case

To get the objective function on the constraints that have been determined in this study, it is simulated in several scenarios;

- 1) Scenario 1 (S-1). Normal Case
- 2) Scenario 2 (S-2). Optimal placement and sizing DG and capacitor bank with network reconfiguration simultaneously [8].
- 3) Scenario 3 (S-3). Optimal Placement and Sizing Single Tune Filter in Scenario 1.
- 4) Scenario 4 (S-4). Optimal Placement and Sizing Single Tuned Filter in Scenario 2.

IV. RESULT AND DISCUSSIONS

The simulation results of the proposed method through the MATLAB 2018B program tested on the IEEE 69-bus standard system are described in the following section.

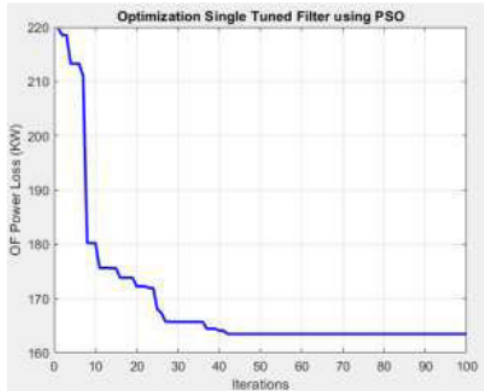


Fig 3. Iteration in Scenario 3.

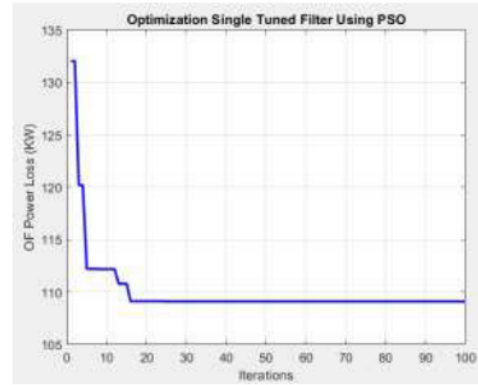


Fig 4. Iteration in Scenario 4.

The value of total power losses for fundamental and harmonic orders are calculated. The result of PSO is shown in Fig. 3-6. The optimum size of filter search by PSO is 1819,9 kVAr in bus 61 and converges in 42 iterations for S-3 and 1603,1 kVAr in bus 61 and converges in 16 iterations for S-4. The results of the placement and sizing of the single tuned filter in S-4 is faster than S-3. This is because the system that has been optimized in the previous research, which wasn't optimal for mitigating the harmonic spreads.

The result of analysis of harmonic load flow before and after optimization single tuned filter are shown in Table 2, Fig. 5-6. The Table 2 shows the comparison before and after optimization of active, reactive and total power losses in all scenarios under fundamental, total harmonic orders and total power losses. Figure 5 shows reduction of voltage level bus and Figure 6 shows reduction the harmonic spreads on %THD_v value before and after optimization.

TABLE 2. COMPARISON OF POWER LOSSES BEFORE AND AFTER OPTIMIZATION IN IEEE 69-BUS

Condition	Scenario 1		Scenario 2		Scenario 3		Scenario 4	
	P _{Loss} (kW)	Q _{Loss} (kVAr)	P _{Loss} (kW)	Q _{Loss} (kVAr)	P _{Loss} (kW)	Q _{Loss} (kVAr)	P _{Loss} (kW)	Q _{Loss} (kVAr)
Fundamental	202.77	88.39	122.49	87.26	151.69	65.81	98.43	64.83
Harmonic	66.31	159.44	40.53	163.93	11.72	34.79	10.75	33.21
Total	270.05	248.32	163.04	251.21	163.41	100.60	109.10	98.05

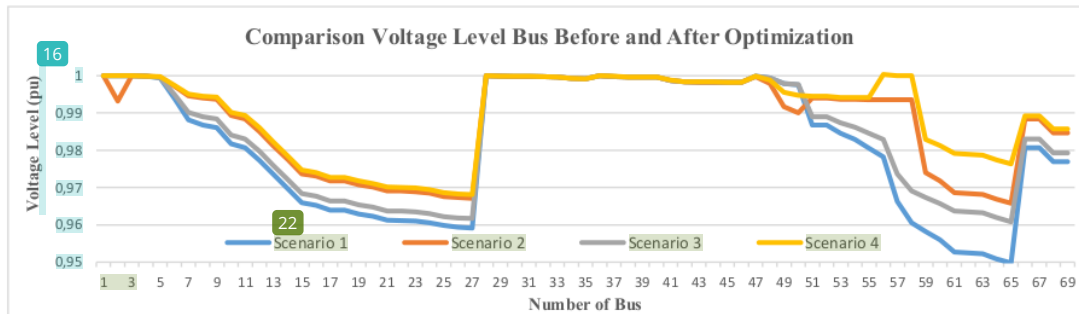


Fig 5. Comparison of voltage level bus before and after optimization in IEEE 69-bus.

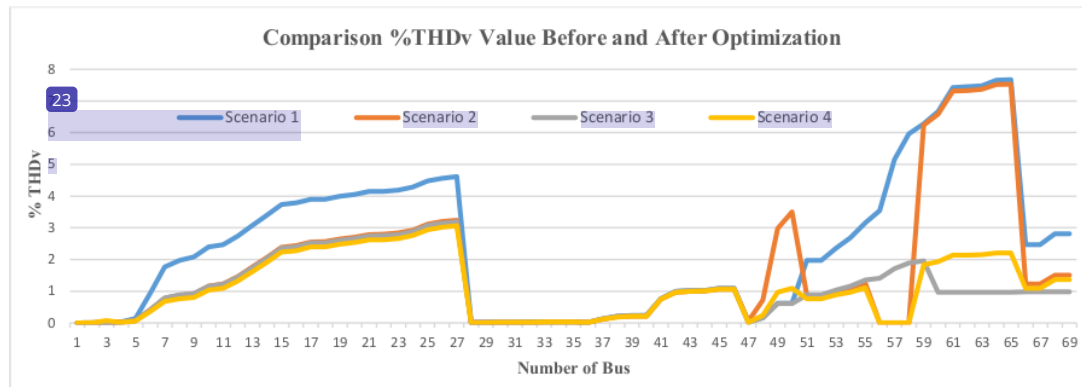


Fig 6. Comparison of %THDv bus before and after optimization in IEEE 69-bus

Table 2 shows the results in the form of decreasing the value of P_{Loss} after optimization. In S-3, it decreases from 270.05 kW to 163.41 kW or 39.48%. In S-4, it decreases from 163.04 kW to 109.1 kW or 33.08%. If scenario 4 is compared to the initial condition (scenario 1), the decrease in P_{Loss} is 160.95 kW or 59.61%.

Figure 5 shows the result in the form of an increase in voltage level (pu) for each bus S-3 and S-4. The best value of voltage level (pu) is in S-4. Figure 6 shows the results in the form of a decrease in average value of %THDv after optimization. In S-3, it decreases from 2.4834% to 1.1113% or 55.25%. In S-4, it decreases from 1.5794% to 1.1128% or 29.54%. If S-4 is compared with the initial condition (scenario 1), the decrease in the average value of %THDv is 1.3705% or 55.18%.

V. CONCLUSION

The use of PSO in optimization a placement and sizing single tuned filter aims to minimize total active power losses and the value of %THDv. It on 33 takes 42 iterations in S-3 28 16 iterations in S-4 for PSO to find the best solution. The IEEE 69-bus radial distribution system is used to validate the result. The best result for test system is 1819.9 kVAR in bus 6 for S-3 and 1603,1 kVAR in bus 6 for S-4. The total P_{Loss} improvement is 23,46 % for S-3, 39,48% for S-4 and 59,61 for S-4 which is compared to initial conditions. The value of average %THDv was reduced by 55.25% for S-3, 29.54% for S-4 and 55.18% for S-4 which is compared to initial conditions. The better result in finding the objective function after optimization on systems that has been optimized previously in previous studies specially in mitigating the spread of harmonics. The next research will discuss the effect filter combination with other optimization techniques in unbalance three phase system for improving power quality.

ACKNOWLEDGMENT

Thank you very much for Mr. Ilham for help us in grammar writing, all of Lecturer in Mechatronic and Electrical Engineering Polytechnic of Bosowa Makassar.

REFERENCES

[1] E.K. Robati, M.S. Sepaslan, "Passive Harmonic Filter Planning Considering Daily Load Variation and Distribution System Reconfiguration," *Elsevier Electric Power Systems Research*, Vol. 166, pp. 125-135, 2019.

[2] I.W. Rinas, "Analisis Perbandingan Penggunaan Filter Pasif dan Filter Aktif Untuk Menanggulangi Terhadap Pada Sistem Kelistrikan di Ruang Puskom Jurusan Teknik Elektro Fakultas Teknik Universitas Jayana," *Jurnal Teknologi Elektro*, Vol. 10, pp. 20-26, 2011.

[3] W. Prasetyadi, R. S. Wibowo, dan O. Penangsang, "Evaluasi Harmonisa dan Perencanaan Filter Pasif Pada Sisi Tegangan 20 kV Akibat Penambahan Beban Pada Sistem Kelistrikan Pabrik Semen Tuban," *Jurnal Teknik POMITS*, Vol. 1, pp 1-6, 2012.

[4] A. S. Abbas, E. S. Ali, R. A. El-Sehiemy, A. A. A. El-Ela and K. M. Fetyan, "Comprehensive Parametric Analysis of Single Tuned Filter in Distribution Systems," *2019 21st International Middle East Power Systems Conference (MEPCON)*, Cairo, Egypt, pp. 465-472, 2019.

[5] S.H.E.A. Aleem, M.E. Balci, S.Sakar, "Effective Utilization of Cable and Transformer Using Passive Filter for Nonlinear Load," *Elsevier International Journal Electrical Power Energy System Research*, Vol 71, pp. 344-350, 2022.

[6] M. Mohammad, A.M. Rozbahani, M. Montazeri, "Multi Criteria Simultaneous Planning of Passive Filter and Distributed Generation Simultaneously in Distribution Systems Considering Nonlinear Loads with Adaptive Bacterial Foraging Optimizations Approach," *Elsevier International Journal Electrical Power Energy System Research*, Vol 79, pp. 253-262, 2016.

[7] Suyanto, C. Rahmadhani, A. Soeprijanto, O. Penangsang, "Power-Flow Development Based on the Modified Backward Forward for Voltage Profile Improvement of Distribution System", *International Journal of Electrical and Computer Engineering*, Vol. 6, No. 5, 2005-2014, 2016.

[8] J. Teng, C. Chang, "Backward Forward Sweep-Based Harmonic Analysis Method for Distribution System," *IEEE Transaction on Power Delivery*, Vol. 22, No. 3, pp. 1665-1672, 2007.

[9] A. Denyal, O. Penangsang, D.A. Asfani, "Modelling of Radial Distribution System for Three-Phase Harmonic Power Flow Studies", *Jurnal Teknik POMITS*, Vol. 1, No. 1, 1-6, 2013.

[10] A.K. Tagore, A.R. Gupta, "Harmonic Load Flow Analysis of Radial Distribution System in Presence of Distributed Generation", *International Conference on Power and Embedded Drive Control (ICPEDC)*, 2017.

[11] O. Amanifar, "Optimal distributed generation placement and sizing for loss and THD reduction and voltage profile improvement in distribution systems using Particle Swarm Optimization and sensitivity analysis," *16th Electrical Power Distribution Conference*, Bandar Abbas, 2011, pp. 1-7, 2011.

[12] M.D. Faraby, O. Penangsang., "Impact Optimal DG Placement Against Harmonic Distribution on Reconfiguration Distribution Network on Microgrid System," *IOP Conference Series: Material Science and Engineering*, Vol. 676, 2018.

[13] S.H. Rayes, P. Salmerson, "Harmonic Disturbance Identification in Electric System with Capacitor Bank", *Elsevier Journal Electric Power and Electrical System*, Vol 82, Issues 1, 18-26, 2012.

[14] S. Jazebi, M.M. Hadji, R.A. Naghizadeh, "Distribution Network Reconfiguration in the Presence of Harmonic Load : Optimization Techniques and Analysis", *IEEE Transaction on Smart Grid*, Vol. 5, No. 4, 1929-1937, 2014.

- [15] H. Shareef, A.A. Ibrahim, N. Salman, A. Mohamed, W.L. Ai, "Power Quality and Reability Enhancement in Distribution System Via Optimum Network Reconfiguration by Using Quantum Firefly Algorithm," *Elsevier International Journal Electrical Power Energy System Research*, Vol 58, pp. 160-169, 2014.
- [16] M.D. Faraby, O. Penangsang, "A Study of Harmonic Spreading Against Distribution Network Reconfiguration in Passive Radial Distribution System", International Conference on Science and Technology, 2018.
- [17] M.D. Faraby, O. Penangsang, R.S. Wibowo, A. Sonita, "Improved Performance Network Reconfiguration in Coordinated Planning in Radial Distribution System Considering Harmonic Distortion", *International Review on Modelling and Simulations*, Vol. 14, No. 2, pp. 146-157, 2021.
- [18] M.D. Faraby, O. Penangsang, R.S. Wibowo, A. Fitriati, "Coordinated Planning in Improving Power Quality Considering the Use of Nonlinear Load in Radial Distribution Netwok", *International Journal of Electrical and Computer Engineering*, Vol. 11, No. 6, pp. 4610-4621, 2021.
- [19] M.D. Faraby, A. Fitriati, Christiono, Usman, A. Muchtar, A.N. Putri, "Single Tuned Filter Planning to Mitigate Harmonic Polluted in Radial Distribution Network Using Particle Swarm Optimization", 2020 3rd International Seminar on Research of Information Technology and Intelligent Systems (ISRITI), pp. 418-422, 2020.
- [20] A. Rosyadi, O. Penangsang, A. Soeprijanto, "Optimal Filter Placement and Sizing in Radial Distribution System Using Whale Optimization Algorithm," 2017 International Seminar on Intelligent Technology and Its Application," pp. 87-92, 2017.
- [21] A. S. Abbas, E. S. Ali, R. A. El-Schiemy, A. A. A. El-Ela and K. M. Fetyan, "Comprehensive Parametric Analysis of Single Tuned Filter in Distribution Systems," 2019 21st International Middle East Power Systems Conference (MEPCON), Cairo, Egypt, pp. 465-472, 2019.
- [22] M. Aghaei, A. Dastfan, "A Graph Search Algorithm; Optimal Placement of Passive Filter in a Power System," *Journal AI Data Min*, Vol. 3, pp. 217-224, 2015.
- [23] F. M. Alhaddad and M. El-Hawary, "Optimal Filter Placement and Sizing Using Ant Colony Optimization in Electrical Distribution System," 2014 IEEE Electrical Power and Energy Conference, Calgary, AB, pp. 128-133, 2014.
- [24] J. Kennedy, R. Eberhard, "Particle Swarm Optimization," *International Conference Neural Network, Piscataway, NJ*, pp. 1942-1948, 1995.

ORIGINALITY REPORT

16%

SIMILARITY INDEX

11%

INTERNET SOURCES

10%

PUBLICATIONS

5%

STUDENT PAPERS

PRIMARY SOURCES

1	Submitted to Eastern Mediterranean University Student Paper	1%
2	Submitted to University of Wollongong Student Paper	1%
3	Submitted to Universitas Diponegoro Student Paper	1%
4	erepo.unud.ac.id Internet Source	1%
5	Ingrid Retha Botha, Glen Bright, James Edward Thomas Collins. "Impact of the Synthesis Procedure of Diaphragm-Shaped Dielectric Elastomers on the Performance as Novel Miniature Actuators", 2021 3rd International Conference on Electrical, Control and Instrumentation Engineering (ICECIE), 2021 Publication	1%
6	comengapp.unsri.ac.id Internet Source	1%

7	<p>Marwan Marwan, Nurhayati, Nur Aminah, Rusdi Wartapane, Muhammad Ilyas Syarif, Ibrahim Abduh. "Designing smart waste management under a wireless communication system", 2021 International Conference on Artificial Intelligence and Computer Science Technology (ICAICST), 2021</p> <p>Publication</p>	1 %
8	<p>iaescore.com</p> <p>Internet Source</p>	1 %
9	<p>Submitted to Universidad Estadual Paulista</p> <p>Student Paper</p>	1 %
10	<p>www.e3s-conferences.org</p> <p>Internet Source</p>	1 %
11	<p>Reza Sarwo Widagdo, Kukuh Setyadjit, Izzah Aula Wardah. "Analysis and Mitigation of Harmonics Distortion with Optimization Capacitor Banks and Single-Tuned Passive Filters", Jambura Journal of Electrical and Electronics Engineering, 2023</p> <p>Publication</p>	1 %
12	<p>Ashokkumar Lakum, Vasundhara Mahajan. "A novel approach for optimal placement and sizing of active power filters in radial distribution system with nonlinear distributed generation using adaptive grey wolf</p>	1 %

13

Igor D. Melo, José L.R. Pereira, Abilio M. Variz,
Paulo F. Ribeiro. "Allocation and sizing of
single tuned passive filters in three-phase
distribution systems for power quality
improvement", Electric Power Systems
Research, 2020

Publication

1 %

14

Aliva Routray, Khyati D Mistry, Sabha Raj Arya.
"Power loss minimization in radial distribution
systems with obstructed solar astronomical
model and temperature effect using grey wolf
optimization technique", Energy Sources, Part
A: Recovery, Utilization, and Environmental
Effects, 2020

Publication

<1 %

15

"Intelligent Computing Techniques for Smart
Energy Systems", Springer Science and
Business Media LLC, 2020

Publication

<1 %

16

acikbilim.yok.gov.tr

Internet Source

<1 %

17

jglobal.jst.go.jp

Internet Source

<1 %

18

Submitted to SASTRA University

Student Paper

<1 %

19

Rueda-Medina, Augusto C., John F. Franco, Marcos J. Rider, Antonio Padilha-Feltrin, and Rubén Romero. "A mixed-integer linear programming approach for optimal type, size and allocation of distributed generation in radial distribution systems", Electric Power Systems Research, 2013.

Publication

<1 %

20

coek.info

Internet Source

<1 %

21

ieomsociety.org

Internet Source

<1 %

22

ora.ox.ac.uk

Internet Source

<1 %

23

semspub.epa.gov

Internet Source

<1 %

24

ecos.fws.gov

Internet Source

<1 %

25

journal.esrgroups.org

Internet Source

<1 %

26

pp.bme.hu

Internet Source

<1 %

27

uniassignment.com

Internet Source

<1 %

28

Manafi, H., N. Ghadimi, M. Ojaroudi, and P. Farhadi. "Optimal Placement of Distributed Generations in Radial Distribution Systems Using Various PSO and DE Algorithms", *Electronics And Electrical Engineering*, 2013.

Publication

<1 %

29

discovery.researcher.life

Internet Source

<1 %

30

publications.waset.org

Internet Source

<1 %

31

tudr.thapar.edu:8080

Internet Source

<1 %

32

www.gigapaper.ir

Internet Source

<1 %

33

Mohd Johan, Nur Fairuz, Azralmukmin Azmi, Mohd Abdur Rashid, Shamsul Bahar Yaakob, Siti Rafidah Abdul Rahim, and Samila Mat Zali. "Multi-objective using Artificial Bee Colony optimization for distributed generation placement on power system", 2013 IEEE International Conference on Control System Computing and Engineering, 2013.

Publication

<1 %

Exclude quotes On

Exclude matches Off

Exclude bibliography On