




PRZEGŁĄD ELEKTROTECHNICZNY

ROK 100

WYDAWNICTWO
SIGMA-NOT



cena 85 zł
(w tym 8% VAT)

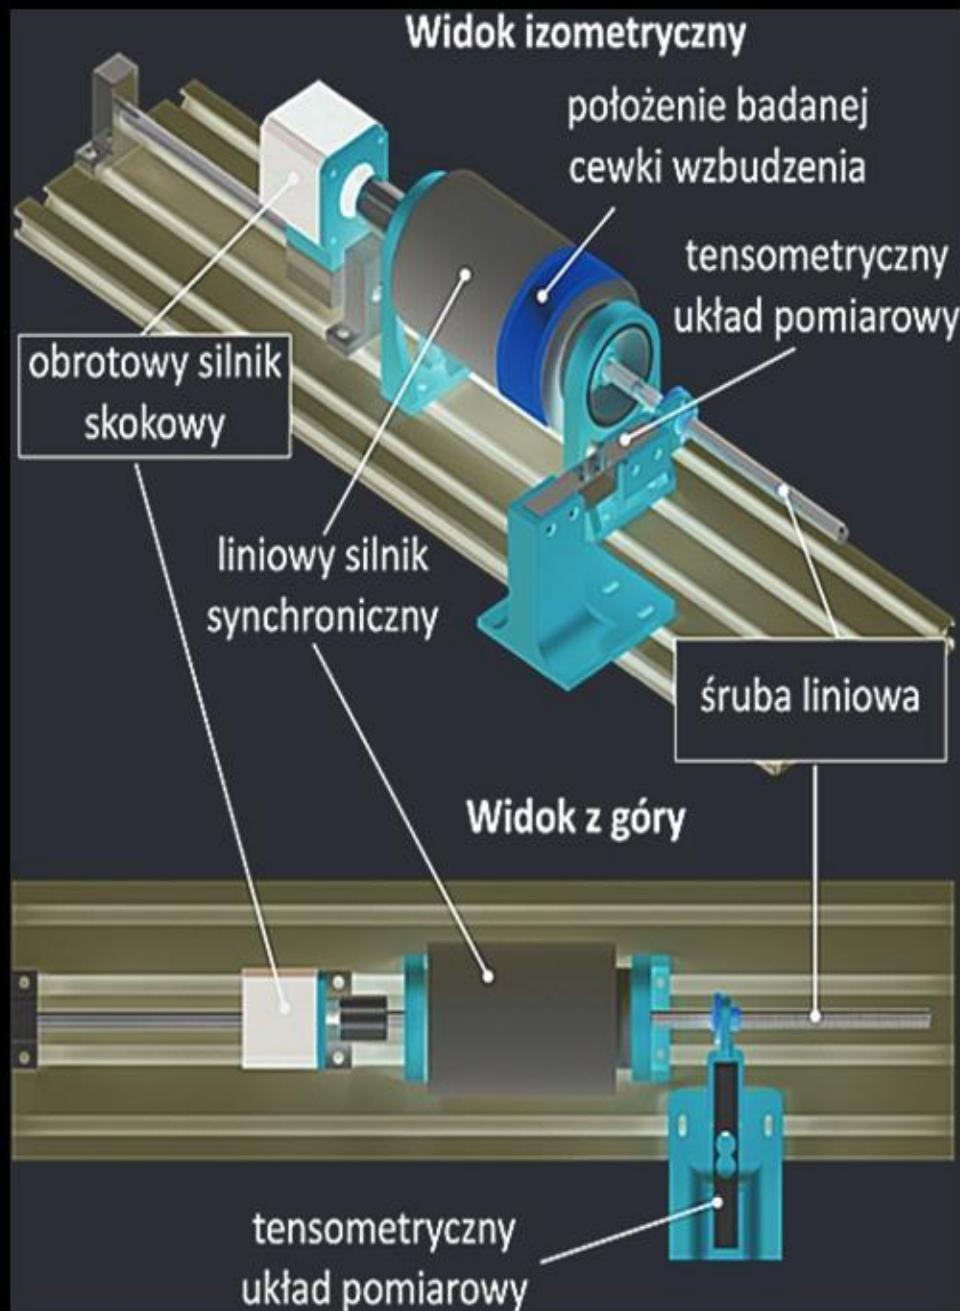

Test sstand for determinning the distribution of
electromagnetic force acting in a linear cylindrical
synchronous motor – page 50

Contents

01	Abdalrhman Adel, Osama A. Omer , M. Alamir, M. Anwar, C. Qunsheng, Amir Almslmany- A Unique Optical System Design and Implementation of X-Ray system to Non-destructive Tests Solid Fuel missiles	1
02	Abdallah BELABBES, Anouar LAIDANI, Amina YACHIR, Allal El Moubarek BOUZID, Riyadh BOUDDOU, Omar Abdelaziz LITIM - Advanced Control of PMSG-based Wind Energy Conversion System Using Model Predictive and Sliding Mode Control	10
03	Islam M. Ibrahim, Nada I. Farah, Mohamed I. Ahmed, Hala M Abdelkader, Ahmed Jamal Abdullah Al-Gburi, Zahriladha Zakaria, Rania H. Elabd, M. M. Elsherbini- A Composite Matrix of Mm-Wave Antenna Arrays for 5G Applications	17
04	Ahmed Nour El Islam AYAD, *Houari BOUDJELLA, Wafa KRIKA, Ilies REZZAG BARA, Benyekhlef LAROUCI - Simulation of Electrical Trees Grow in Three-Core Submarine Cable	23
05	Hiba-Allah T. Abdullah, Riyadh Zaghloul Mahmood, Sanabel M. Alhaj Zber, Rasha A.Mohammed, Marwa Riyad Ahmed, Azhar W. Talab - FPGA-Based Three Edge Detection Algorithms (Sobel, Prewitt and Roberts) Implementation for Image Processing	29
06	Małgorzata ŁATKA - Analysis of selected electric power quality parameters in urban and regional low-voltage power grids with the participation of distributed generation in the selected area	34
07	Miroslaw WCIŚLIK, Robert KAZAŁA - Simulation analysis of a balanced three-phase AC circuit with nonlinear load	38
08	Miroslaw PAROL - Microgrids – energy micro-systems supplying energy receivers. Current state and development perspectives	44
09	Sebastian BARTEL, Krzysztof KLUSCZYŃSKI, Zbigniew PILCH - Test stand for determining the distribution of electromagnetic force acting in a linear cylindrical synchronous motor with a permanent magnet	50
10	Sebastian BARTEL, Krzysztof KLUSCZYŃSKI - The issue of selecting the geometric proportions of excitation coils in a linear cylindrical synchronous motor with a permanent magnet as a running gear	55
11	Stanislaw CZAPP - Residual current devices in electric vehicles charging installations	62
12	Wiktoria GRYCAN – Legislative Assistance for Prosumer Energy within the Framework of Electrical Safety of Power Network	66
13	Marek JAWORSKI - The influence of the structure of supports and the phase system on the distribution of electric and magnetic fields in the vicinity of 400 kV lines	70
14	Jakub Beling, Dorota Rabczuk - Selection of digital filters for measurements of photoplethysmographic signals	74
15	Sylwia BERDOWSKA - Analysis of the electricity generation potential in the sloped solar chimney power plant	78
16	Machmud Effendy, Dandy Dwi Saputra, Fourys Yudo Setiawan Paisey - Power Flow Analysis of Distributed Generation and Distributed Storage (DGDC) in DC Microgrid Using Newton Raphson Method	84
17	Artur BUGAŁA, Antoni ARENDACZ, Dorota BUGAŁ - Performance evaluation of bifacial photovoltaic module operating in standard and dedicated support structure	87
18	Hari Agus Sujono, Achmad Saiful Faris - Design of A Beef Freshness Detector based on Color and Scent with the Mamdani Fuzzy Method	92
19	Keltoum MOURADJ , Mustapha KHELIFI, Abdesselam BASSOU, Mohamed Rida LAHCENE - Improvement of QoS for 5G System using UTTCM coder over EPA channel	97
20	Ahmad BOUSSOUFA, Aimad AHRICHE, Madjid KIDOUCHE, Mohammed Zinelabidine DOGHMANE - Discretization Order Influences on Extended Kalman Filter Estimation for Doubly-Fed Induction Generator	102
21	Abderrahim ZEMMIT, Sabir MESSALTI, Abdelghafour HERIZI - New Direct Torque Control of Dual Star Induction Motor using Grey Wolf Optimization Technique	109
22	Nur HAMZAH, Suryanto SURYANTO, Muhammad ANSHAR, Firman FIRMAN, Muhammad Ruswandi DJALAL, Muhammad Alif AL AFGAN - Thermodynamic Modelling of Waste to Energy Power Plant: A Case Study in Makassar City, Indonesia	114
23	Vadim MANUSOV, Alibek KIRGIZOV, Murodbek SAFARALIEV, Inga ZICMANE, Svetlana BERYOZKINA, Sherkhon SULTONOV - Stochastic Method for Predicting the Output of Electrical Energy Received from a Solar Pane	118
24	Oleksandr Sinyavsky, Vitaliy Savchenko, Andrii Nesvidomin, Vasyl Bunko, Vasyl Ramsh, Mykola Potapenko - Influence of the electricity quality on the energy characteristics of agricultural machines	123
25	Benmebarek, L. Alloui, Y. Gabi, S. M. Mimoune, B. Wolter - Three-Dimensional Numerical Modelling of Eddy Current System Using the Finite Volume Method	127
26	Ilham RAHIMLI, Aliashraf BAKHTIYAROV, Gulshan ABDULLAYEVA, Sona RZAYEVA - Application Of Optical Current Sensors In Electric Substations	132
27	Ilkin Marufov , Najiba Piriyeva, Nijat Mammadov, Shukufa Ismayilova⁴ - Calculation of induction levitation vertical axis wind generator-turbine system parameters, levitation and influence loop	135
28	Andi Abdul Halik LATEKO, Yusri Syam AKIL - A VECM Analysis of the Impact of Economic Growth and Investment on Electricity Consumption in Indonesia	140
29	Angati Kalyan KUMAR, Tsehay Admassu ASSEGIE, Ayodeji Olalekan SALAU, Komal Kumar NAPA, Suguna R - Feature Contribution to an In-Depth Understanding of the Machine Learning Model Interpretation	145
30	Mustafa HAMIDOV, Elbrus AHMEDOV, Hamida HAMIDOVA, Sona RZAYEVA⁴ - Analysis and development of a mathematical model of the acoustic method for monitoring downhole parameters of the drilling process	149

Contents

31	Anatolii SEMENOV, Stanislav POPOV, Serhii YAKHIN, Bauyrzhan YELEUSSINOV, Tamara SAKHNO¹-	152
	Assessment of the danger of using ultraviolet lamps in electrical systems	
32	Hryhorii KALETKA, Vitalii YAROPUD, Yurii POLIEVODA, Olena SOLONA, Ihor BABYN, Ihor TVERDOOKHLIB - Study of the process of active-ventilation drying of legume grasses' fractional processing products	156
33	Nataliia LUTSKA, Nataliia ZAIETS, Lidiia VLASENKO - Development of Diagnostic System for the State of Electric Drives of Food Enterprise	164
34	Muhammad Tajammal Chughtai - Harvesting voltage using knitted structures	168
35	Hafizudin Fikri KHAIRUDIN, Suziana AHMAD, Mohd Zaidi Mohd TUMARI, Amirul Syafiq SADUN, Izadora MUSTAFFA¹ - IoT-based Water Surface Cleaning Robot with Live Streaming	172
36	Siti Fatimah SULAIMAN, Nurul Aini NGATENI, Khairuddin OSMAN, Sharatul Izah SAMSUDIN, Noor Asyikin SULAIMAN, Noorhazirah SUNAR - Modeling and Development of Predictive Controller for Positioning Control of Electro-Hydraulic Actuator (EHA) System	177
37	Wittawat WASUSATHIEN, Chanchai THONGSOPA, Samran SANTALUNAI, Thanaset THOSDEEKORAPHAT, Nuchanart SANTALUNAI - Measurement of Dielectric Properties in Mixtures of Various Rice Cultivars for Purpose of Detecting Contamination in Industry	182
38	Sabir BAGHIROV, Yulia BASOVA, Liudmyla GUBA, Hryhorii KOZHUSHKO - Prediction of the Service Life of LED Lamps Based on the Extrapolation of the Luminous Flux Conservation Factor	190
39	Saad Alhamid, Omar hamandouch, Ahmed Haj Darwish - A hybrid Bees Algorithm to Enhance the Performance of Radial distribution system	193
40	Antoni Różowicz, Mariusz Deląg - Resonant UV radiation as a function of the frequency of the current in the lamp circuit and the working environment conditions	197
41	Sebastian Różowicz, Mariusz Deląg - Design and tests for compliance with Regulation 65 on the example of a special warning lamp	200
42	Piotr Jankowski, Damian Hallmann - Simulation study of the dynamic-thermal properties of an ultra-fast inductive-dynamic drive	203
43	Maciej WŁODARCZYK, Andrzej ZAWADZKI, Sebastian RÓŻOWICZ - Analysis of the possibility of extending the method of three ordinates and applying to nonlinear elements with hysteresis	209
44	Sebastian RÓŻOWICZ, Maciej WŁODARCZYK, Andrzej ZAWADZKI¹ - Some remarks on the symmetry of passive two-ports in steady and transient states	214
45	Marcin POŁOMSKI, Tomasz KRASZEWSKI, Artur PASIERBEK, Anna PIWOWAR, Magdalena KRASZEWSKA - Structured light scanning method in the detection of workpiece defects	217
46	KAZIMIERZ KAWA, RAFAŁ MULARCZYK, WALDEMAR BAUER, EDYTA KUCHARSKA - Impact of external factors on electricity consumption prediction in office building with photovoltaic supply	221
47	Daniel ZEJLER, Piotr ZIENTEK² - Special sensors in fire alarm systems applications	227
48	Tomasz Kossowski, Paweł Szczupak - Analysis of the electric field distribution in the parallel-plate capacitor designed for testing the immunity of electrical devices to lightning electromagnetic pulse	232
49	Piotr Warda - The method of dynamic selection of the clock frequency of the frequency-to-code converter	235
50	Jacek KOZYRA, Zbigniew ŁUKASIK, Aldona KUŚMIŃSKA-FIJAŁKOWSKA - An analysis of selected aspects of transmission capacity for replacement of overhead power lines with cable lines	241
51	Ayoob Alateeq - Design of a three-phase multilevel inverter using a SC cell for photovoltaic use	248
52	Majid H. ABDULLAH, Petar BIŠEVAC, Ratko IVKOVIĆ, Petar SPALEVIĆ, Srđan Milosavljević - Utilizing Artificial Intelligence for Text Segmentation from Images	255
53	T Praveen Kumarar, S Ganapathy, M Manikandan - Voltage Stability Analysis for Grid Connected PV System using Optimized Control on IOT based ANFIS	259
54	Titiek Suheta, Syahri Muharom, Misbahul Munir - Analysis of Monocrystalline and Polycrystalline Solar Panels in Small-Scale Power Generation Systems Based On Microcontrollers	267
55	Abdelhalim Ghediri, Noureddine Goléa - Induction motor failures detection using Motor Current Signal Analysis (MCSC) and two-step Support Vector Machine (SVM) classifier	272
56	Taha RACHDI, Yahia SAOUDI, Larbi CHRIFI-ALAOUI, Ayachi ERRACHDI - Performance Enhancement of Smart Grid Using an Optimal Placement of FACTS: Case of TCSC	279
57	Irena DROFOVA, Martin HROMADA, Milan ADAMEK, Jan VALOUCH, Pavel WANECKI - 360 scanning devices for the reconstruction of 3D digital twins	286
58	Hemza Medoukali, Boubakeur Zegnini, Mossadek Guibadj - Study of DC Voltage Effects on the Electrical Treeing Phenomenon in XLPE Insulating Materials	290
59	Damian BURZYŃSKI, Leszek KASPRZYK - State of available energy prediction model for lithium-iron-phosphate cells	294

Thermodynamic Modelling of Waste to Energy Power Plant: A Case Study in Makassar City, Indonesia

Abstract. Waste is a major problem in big cities in Indonesia, one of which is Makassar City. Every year the amount of waste generated by the residents of Makassar City continues to increase, but this is not proportional to the capacity of the landfill. Therefore, researchers want to design a waste-to-energy power plant system in Makassar City or other words apply the waste-to-energy concept. The waste-to-energy concept aims to process waste into energy and reduce the volume of waste in landfills. Then the research method used is thermodynamic modelling using STEAG Epsilon Professional version 13.02 software. From this analysis it was found that the capacity of the waste that can be burned is 742,648 tons/day, the thermal input of the incinerator is 39.011 MW, the thermal capacity of the boiler is 30.749 MW, the thermal efficiency of the waste-to-energy boiler with direct method 83.123 % and with indirect method 82.107 %, the mechanical power of the steam turbine is 10.816 MW, the heat duty of the high-pressure feed-water heater is 1,681,321 kW, the heat duty of the low-pressure feedwater heater is 1,780,234 kW, and the cooling duty of the air-cooled condenser 20.337 MW. This design has a net thermal efficiency of 24.110%, a gross plant heat rate of 12,683.130 kJ/kg, a net plant heat rate of 13,816.942 kJ/kg, an auxiliary load of 912.744 kW, a net plant power of 9.638 MWe, the specific fuel consumption 1.124 kg/kWh for each unit at the maximum load, and reducing municipal solid waste generation per year by 271,066.520 tons.

Streszczenie. Odpady stanowią poważny problem w dużych miastach Indonezji, jednym z nich jest Makassar City. Każdego roku ilość odpadów wytwarzanych przez mieszkańców Makassar City stale rośnie, jednak nie jest to proporcjonalne do pojemności składowiska. Dlatego badacze chcą zaprojektować system elektrowni przetwarzających odpady na energię w mieście Makassar, czyli innymi słowy zastosować koncepcję przetwarzania odpadów na energię. Koncepcja waste-to-energy ma na celu przetwarzanie odpadów na energię i zmniejszenie ilości odpadów trafiających na składowiska. Następnie zastosowaną metodą badawczą jest modelowanie termodynamiczne z wykorzystaniem programu STEAG Epsilon Professional wersja 13.02. Z analizy tej wynika, że wydajność spalania odpadów możliwych do spalenia wynosi 742,648 ton/dobę, moc cieplna spalarni wynosi 39,011 MW, moc cieplna kotła wynosi 30,749 MW, sprawność cieplna spalarni -kocioł energetyczny metodą bezpośrednią 83,123 % i metodą pośrednią 82,107 %, moc mechaniczna turbiny parowej 10,816 MW, obciążenie cieplne wysokociśnieniowego podgrzewacza wody zasilającej 1681,321 kW, obciążenie cieplne niskociśnieniowego Moc podgrzewacza wody zasilającej wynosi 1780,234 kW, a wydajność chłodnicza skraplaczka chłodzonego powietrzem 20,337 MW. Konstrukcja ta charakteryzuje się sprawnością cieplną netto wynoszącą 24,110%, współczynnikiem ciepła brutto instalacji wynoszącym 12 683,130 kJ/kg, współczynnikiem ciepła netto instalacji wynoszącym 13 816,942 kJ/kg, obciążeniem pomocniczym wynoszącym 912,744 kW, mocą netto instalacji wynoszącą 9,638 MWe, zużycie paliwa 1,124 kg/kWh na każdą jednostkę przy maksymalnym obciążeniu oraz ograniczenie wytwarzania odpadów komunalnych w skali roku o 271 066,520 ton. (Modelowanie termodynamiczne elektrowni przetwarzającej odpady na energię: studium przypadku w mieście Makassar w Indonezji)

Keywords: Thermodynamic-Modelling, Municipal Solid Waste, Power Plant

Słowa kluczowe: Modelowanie termodynamiczne, odpady komunalne, elektrownia

Introduction

So far, boiler heat energy sources use fossil fuels, while alternative energy sources that can be considered are waste energy sources and renewable energy sources.[1]. One part of waste energy is Municipal solid waste (MSW). MSW is a term usually applied to a heterogeneous collection of wastes produced in urban areas. Generally, urban wastes can be subdivided into two major components: organic and inorganic. The characteristics and quantity of the solid waste generated in a region are a function of the standard of living in the city or country. Wastes generated in developing countries have a large proportion of organic waste, while the wastes in developed countries are more diversified with relatively larger shares of plastics and paper [2]. Almost all economic sectors generate municipal solid waste. Some factors that influence high MSW generation are population and economic growth, education, occupation, consumption patterns, and gross domestic product per capita. With a high gross domestic product,

Indonesia generates large amount of annual municipal solid waste (SW) in ASEAN countries [3]. The annual production of municipal solid waste in Indonesia reaches 31 million tons with the waste composition including food waste at 39.23%, plastic at 18.11%, paper at 12.83%, wood at 12.16%, metal at 3.19%, cloth at 2.55%, glass 2.42%, leather 1.82%, and others 7.69% [4]. Meanwhile, Makassar City's annual solid waste production reaches 1,023,710 tons with a composition of food waste at 54.70%, wood at 11.33%, plastic at 12.20%, paper at 6.78%, textile at 1.30%,

glass at 1.15%, metal 1.07%, battery 0.62%, rubber 0.42% and other 10.43% [5]. Indonesian municipal solid waste has a high moisture content, volatile matter content, as well as carbon and hydrogen content, and contains more organic matter. Moisture content is a major factor impacting calorific value. The lower heating value on the wet basis of the entire municipal solid waste sample is 8.6 MJ/kg, which is not only relatively high compared with the average calorific value, but also above the World Bank-recommended calorific value minimum for waste-to-energy applications. Thermal conversion processes including incineration, pyrolysis, and gasification for heat, bio-oil, and syngas generation are already well established and are being employed in several countries [6]. MSW in Indonesia is suitable for waste-to-energy, whether combustion (incineration) or gasification-based [7].

The concept of waste-to-energy aims to process waste into energy and reduce the volume of waste in landfills. The most commonly used technology for converting waste into energy is incineration [8]. This is because incineration technology provides a more productive way of decreasing the amount of urban solid waste that needs to be landfilled. The incineration of municipal solid waste can minimize its mass by 70% and volume by 90%, as well as electricity and heat recovery [9]. The purpose of this research is to get a waste-to-energy power plant model that is suitable and can solve the waste problems in Makassar City.

Fuel from waste

Makassar City has a daily potential power from the waste of 24.882-33.768 MWe with an LHV variation of 7-8.6 MJ/kg and an average amount of waste of 1,023,710 tons/day in 2021. Makassar City municipal solid waste production data is shown in Table 1.

Table 1. Makassar City municipal solid waste production data [5].

Year	Daily (tons/day)	Yearly (tons/year)
2008	386.826	141,191.49
2009	456.318	166,556.07
2010	532.744	194,451.56
2011	529.878	193,405.47
2008	386.826	141,191.49
2012	557.312	203,418.88
2013	676.632	246,970.68
2014	677.213	247,182.75
2015	674.716	246,271.34
2016	651.649	237,851.89
2017	795.129	290,222.09
2018	707.923	258,391.90
2019	696.585	254,253.53
2020	996.71	363,799.15
2021	1,023.71	373,654.15
Total	9,363.35	3,417,620.93

Waste to energy power plant description

The Makassar City waste-to-energy power plant model consists of two identical units. Each of the two waste-to-energy power plant units has a high-pressure feedwater heater, a low-pressure feedwater, a deaerator, a steam turbine, an electric generator, a boiler, and four air-cooled condenser units. The estimated incinerator capacity of this power plant is 842.7 tons per day with an estimated power that can be generated of 20,482 – 25,164 MWe. The technical data of the Makassar City waste-to-energy power plant model is shown in Table 2.

Table 1 Combustion parameters [10, 11]

Minimum combustion temperature (°C)	850
Maximum combustion temperature (°C)	1450
Primary combustion zone air ratio	<1.2
Secondary combustion zone air ratio	1.7

Table 3 Steam and water cycle parameters [12]

Economizer working pressure (bar)	93.342
Evaporator working pressure (bar)	93.342
Superheater working pressure (bar)	90.623
Economizer working temperature (°C)	250
Evaporator working temperature (°C)	305.974
Superheater working temperature (°C)	449
Economizer pressure drop (bar)	7.468
Evaporator pressure drop (bar)	14
Superheater pressure drop (bar)	0.020

Table 2 Boiler Ratings [8],

Air ratio	1.2
Circulation ratio	5
Air Fuel Ratio for LHV 8.6 MJ/kg	3.409
Flue gas recirculation ratio (%)	15

Table 3 Steam turbine parameters [13, 14]

Steam turbine type	Siemens SST-200
h_1 (kJ/kg), with T=447.464 °C and P=88 bar	3,254.308
h_2 (kJ/kg), with T=337.839 °C and P=40 bar	3,062.643
h_3 (kJ/kg), with T=337.839 °C and P=40 bar	3,062.643
h_4 (kJ/kg), with T=231.363 °C and P=16 bar	2,874.053
h_5 (kJ/kg), with T=231.363 °C and P=16 bar	2,874.053
h_6 (kJ/kg), with T=170.414 °C and P=8 bar	2,751.521
h_7 , (kJ/kg), with T=170.414 °C and P=88 bar	2,751.521
h_8 (kJ/kg), with T=60.059 °C and P=0.2 bar	2,249.696
Isentropic efficiency (%)	88.0
Mechanical efficiency (%)	98.0

Steam turbine speed (rpm)	7,300
Gearbox speed (rpm)	3,000
Controlled extraction	Up to 4
Condensing pressure for air-cooled condenser (bar abs)	0.2

Modelling and simulation of wate to energy power plant

The modelling process was carried out by entering the technical data of the waste power plant into the model as shown in Fig. 1. The simulation process was performed to determine the performance of the model at the maximum load of each unit, which is 10.5 MWe. The performance observed in the model is the amount that can be burned, the thermal capacity of the boiler, the mechanical power of the steam turbine, the heat duty of the high-pressure feedwater heater, the heat duty of the low-pressure feedwater heater, the cooling duty of the air-cooled condenser, net thermal efficiency, net plant heat rate, auxiliary load, net plant power, and specific fuel consumption.

The equation used to calculate the net thermal efficiency of the model is as follows [15]:

$$(1) \quad \eta_{th} = \frac{3,598 \text{ (kJ)}}{\text{Net plant heat rate} \left(\frac{\text{kJ}}{\text{kWh}} \right)}$$

The equation used to calculate the net plant heat rate is as follows [15]

$$(2) \quad NPHR = \frac{(\dot{m}_{fuel} \times LHV) 3,598 \text{ (kJ)}}{(\text{Gross power (kW)} - \text{Auxiliary power (kW)})}$$

The equation used to calculate specific fuel consumption is as follows ([15]):

$$(3) \quad SFC = \frac{\text{Net plant heat rate} \left(\frac{\text{kJ}}{\text{kWh}} \right)}{LHV \left(\frac{\text{kJ}}{\text{kg}} \right)}$$

Result and discussion

After conducting a simulation of the waste power plant model as shown in Fig. 1, the researchers got the results for each unit shown in Table 6.

Table 4 Simulation results of the waste-to-energy power plant model for each unit.

Waste-to-energy power plant system	
Gross thermal efficiency (%)	28.384
Net thermal efficiency (%)	26.055
Gross plant heat rate (kJ/kWh)	12,638.130
Net plant heat rate (kJ/kWh)	13,816.942
Specific fuel consumption (kg/kWh)	1.214
Gross plant power (kW)	10,500.000
Net plant power (kW)	9,638.375
Auxiliary power (kW)	861.625
LHV (MJ/kg)	8.6
Net plant heat rate (kJ/kWh)	13,816.942
Specific fuel consumption (kg/kWh)	1.214
Gross plant power (kW)	10,500.000
Net plant power (kW)	9,638.375
Auxiliary power (kW)	861.625
LHV (MJ/kg)	8.6
Boiler	
Boiler thermal efficiency with direct method (%)	83.123
Boiler thermal efficiency with indirect method (%)	82.107
Boiler heat rate (kJ/kWh)	4,330.937
Firing rate for each unit (ton/day)	371.324
Combustion air (ton/h)	52.745
Combustion temperature (°C)	1,363.416
Thermal input (kW)	39,011.862
Economizer heat load (kW)	3,855.444
Evaporator heat load (kW)	20,481.517
Superheater heat load (kW)	6,412.241

Air preheater heat load (kW)	2,186.724
Useful heat (kW)	30,749.203
Exhaust losses (kW)	4,656.612
Slag losses (kW)	1,891.010
Radiation losses (kW)	153.523
Uncountable losses (kW)	1,561.514
Total heat losses (kW)	8,262.659
Maximum acid dew point (°C)	157.345
Slag (ton/day)	143.098
Fly ash (ton/day)	12.273
Steam turbine	
Inlet mass flow rate (kg/s)	12.401
Extraction 1 mass flow rate (kg/s)	2.076
Extraction 2 mass flow rate (kg/s)	0.647
Exhaust stage mass flow rate (kg/s)	9.679
Gross mechanical power (MW)	10,816.267
Net mechanical power (MW)	10,652.328
Transmission losses (MW)	98.484
Transmission efficiency (%)	163.938
High-pressure feedwater heater	
Hot side mass flow rate (kg/s)	0.585
Cold side mass flow rate (kg/s)	12.041
Heat duty (kW)	1,681.321
Heat load (kW)	815.165
Low-pressure feedwater heater	
Hot side mass flow rate (kg/s)	0.647
Cold side mass flow rate (kg/s)	10.326
Heat duty (kW)	1,780.234
Heat load (kW)	895.898
Air-cooled condenser	
Hot side mass flow rate (kg/s)	10.326
Cold side mass flow rate (kg/s)	791.957
Cold side outlet temperature (°C)	58.042
Heat load (MW)	22,658.250
Cooling duty (MW)	20,337.237
Total required power for fans (kW)	236.600
Electric generator	
Real power (MW)	10.500
Idle power (MVAR)	5.085
Apparent power (MVA)	11.666

Waste to Energy Power Plant Efficiency

From the simulation results, it can be seen that the net thermal efficiency of the waste-to-energy power plant system model is 24.110%. These results are following research conducted by Mutz [16], which states that in general the thermal efficiency of waste-to-energy power plants is 20% this is in line with research conducted by Branchini [8], which states that in general the thermal efficiency of waste power plants ranges from 18% to 25% and in some cases more than 30%.

In addition, the model of the waste power plant system created by the researchers also uses a low air ratio to increase the net thermal efficiency of the waste power plant. This is in line with research conducted by Gablange [11] which states that another benefit of using a low air ratio in a waste power plant is an increase in thermal efficiency.

Waste to Energy Boiler Efficiency

From the simulation results, it can be seen that the boiler thermal efficiency obtained is 83.123 % with the direct method and 82.107 % with the indirect method. These results are equal to the results of research conducted by Schu and Leithner [17], which state that the efficiency of the thermal waste-to-energy boiler is around 83%.

System Heat Balance

From the simulation results, it can be seen that the model of the waste-to-energy power plant system experiences the greatest heat losses in the air-cooled condenser and stack. The Sankey diagram of the model of the waste-to-energy power plant system can be seen in Fig. 2. The heat losses that occur in the air-cooled condenser are 20.337 MW or 50.237 % of the system. This happens because all the steam that has been used by the steam turbine and closed feedwater heater flows into the water-cooled condenser to change the phase from steam to water by removing the latent heat from the steam. So that the steam that has changed phase to water can flow back to the boiler. The heat losses that occur in the stack (exhaust losses) are 4.656 MW or 15.114 %. This is due to the temperature of the flue gas released into the atmosphere through the stack is high, which is 160 °C which then causes a lot of heat to be wasted from the flue gas.

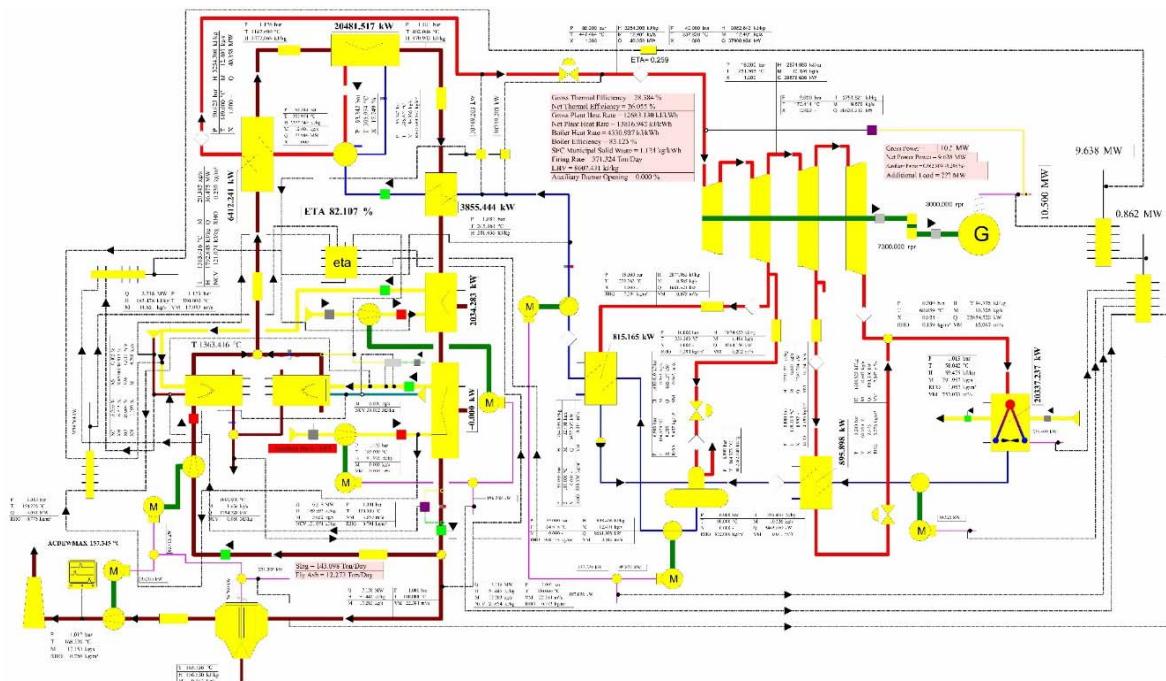


Fig.1. An example of the figure inserted into the text Model of waste-to-energy power plant system using STEAG Epsilon Professional

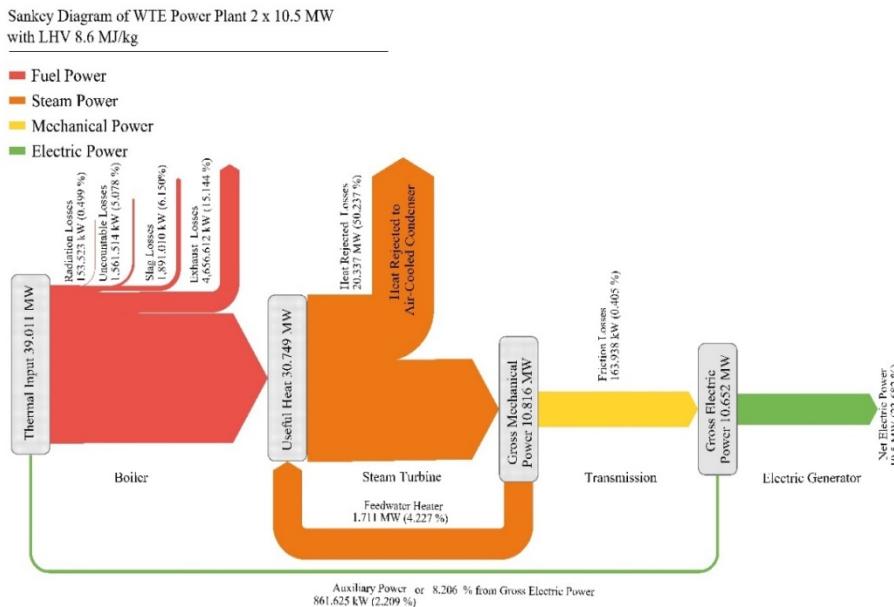


Fig. 2. Sankey diagram from the model of waste-to-energy power plant system.

Conclusion

The thermodynamic modelling using STEAG Epsilon Professional software version 13.02 was presented. The model of the waste-to-energy power plant for Makassar City has an incinerator daily capacity of 371.323 ton/day at the maximum load of 10.5 MWe for each unit, the thermal capacity of the waste-to-energy boiler is 30,749 MW, the thermal efficiency of the waste-to-energy boiler is 83.123 %, the thermal efficiency of the waste-to-energy boiler, the mechanical power of the steam turbine is 10.816 MW, the heat duty of the high-pressure feedwater heater is 1,681.321 kW, the heat duty of the low-pressure feedwater heater is 1,780.234 kW, and the cooling duty of the air-cooled condenser 20.337 MW, the net thermal efficiency is 26.055%, the net plant heat rate is 13,816.942 kJ/kWh, the auxiliary load is 912.744 kW, a net plant power of 9.638 MWe, the specific fuel consumption is 1.124 kg/kWh with LHV 8.6 MJ/kg. This waste-to-energy power plant model is suitable to be implemented and can solve waste problems in Makassar City.

Authors: Assoc Prof Nur Hamzah,, Politeknik Negeri Ujung Pandang, Jl. Perintis Kemerdekaan KM 10 Makassar Indonesia E-mail: hamzah_said@poliupg.ac.id;

REFERENCES

- [1] P. Kolasiński, Use of the renewable and waste energy sources in heat storage systems combined with ORC power plants, *Przeglad Elektrotechniczny*, vol. 89, (2013), no. 7, pp. 277-279, 01/01 2013.
- [2] H. Sudibyo, A. Majid, Y. Pradana, W. Wiratni, D. Aan, and A. Budiman, *Technological Evaluation of Municipal Solid Waste Management System in Indonesia*. 2017, pp. 263-269.
- [3] P. Lestari and Y. Trihadiningrum, The impact of improper solid waste management to plastic pollution in Indonesian coast and marine environment, *Marine Pollution Bulletin*, vol. 149, (2019), no. p. 110505, 2019/12/01/ 2019.
- [4] Ministry of Environment and Forestry Republic of Indonesia, Indonesia's Municipal Solid Waste Production in 2021., (2022),no. 2022.
- [5] Department of The Environment of Makassar City, "City Municipal Solid Waste Production Report in 2021," Department of The Environment of Makassar City, Makassar2022.
- [6] C. Ram, A. Kumar, and P. Rani, Municipal solid waste management: A review of waste to energy (WtE) approaches, *BioResources*, vol. 16, (2021), no. 2, pp. 4275-4320., 2021.
- [7] Z. Zongao et al., Experimental study on characteristics of municipal solid waste (MSW) in typical cities of Indonesia, *Progress in Energy & Fuels*, vol. 8, (2020), no. p. 13, 04/16 2020.
- [8] L. Branchini, *Waste-to-Energy: Advanced Cycles and New Design Concepts for Efficient Power Plants*. New York.: Springer International Publishing, , 2015.
- [9] D. Cudjoe and P. M. Acuah, Environmental impact analysis of municipal solid waste incineration in African countries, *Chemosphere*, vol. 265, (2021), no. p. 129186, 2021/02/01/ 2021.
- [10] C. e. a. Liu, C. Liu, T. Nishiyama, K. Kawamoto, and S. Sasaki, CCET Guidelines Series on Intermediate Municipal Solid Waste Treatment Technologies Waste to Energy Incineration., *IETC Technology for Environment and Institute for Global Environmental Strategies.*, (2020), no. 2020.
- [11] R. Strobel, M. H. Waldner, and H. Gablunger, Highly efficient combustion with low excess air in a modern energy-from-waste (EfW) plant, (in eng), *Waste Manag*, vol. 73, (2018), no. pp. 301-306, Mar 2018.
- [12] J. B. Kitto and S. C. Stultz., J. B. Kitto and S. C. Stultz, Eds. *Steam: Its Generation and Use*, 41st ed. ed. Babcock & Wilcox Company, 2005.
- [13] L. Branchini, *Waste-to-Energy, Advanced Cycles and New Design Concepts for Efficient Power Plants*. Switzerland Springer International Publishing 2015.
- [14] S. AG, "Siemens Steam Turbine Portfolio," 2019.
- [15] Black and Veatch, *Power Plant Engineering*. Boston: Springer, 1996.
- [16] D. Mutz, D. Hengevoss, C. Hugi, and D. Hincliffe, *Waste-to-Energy Options in Municipal Solid Waste Management - A Guide for Decision Makers in Developing and Emerging Countries*. 2017.
- [17] R. Schu and R. Leithner, "Waste to energy-Higher efficiency with external superheating," in *Proceedings 2nd International Symposium on Energy from Biomass and Waste*, Venice, Italy, 2008.